


Noticed-Alternative Southern Route

- ▲ Substation
- ▲ Switching Station
- ▲ Switching Station (Proposed)
- Junction
- 345-kV Overhead**
- 345-kV New Construction
- Southern Route Corridor
- 115-kV Overhead**
- ▲— 115-kV Improvements
- ▲— 115-kV Existing to Remain in Corridor

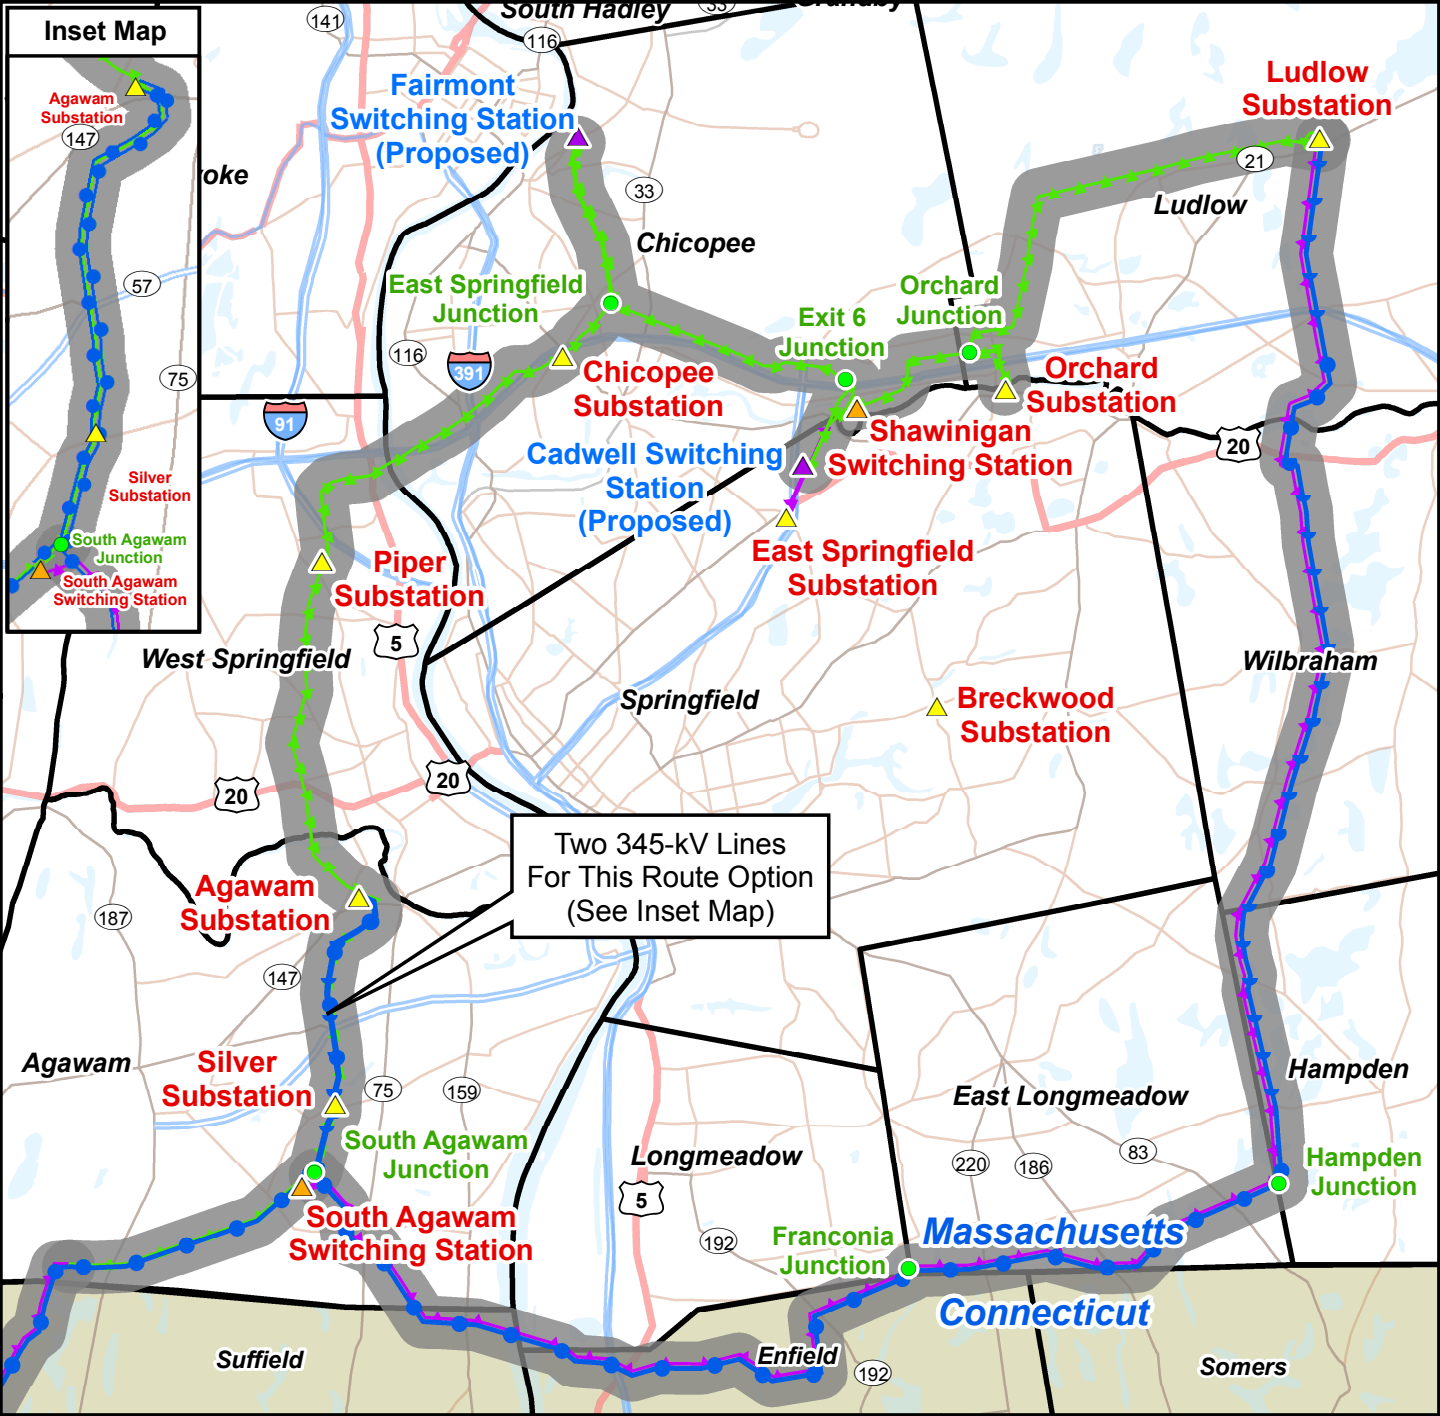

Project Location Map
 Greater Springfield Reliability
 Project
 Noticed-Alternative Southern Route